


SW FIFTH AVENUE

A, B, C, D, E, F, G, H

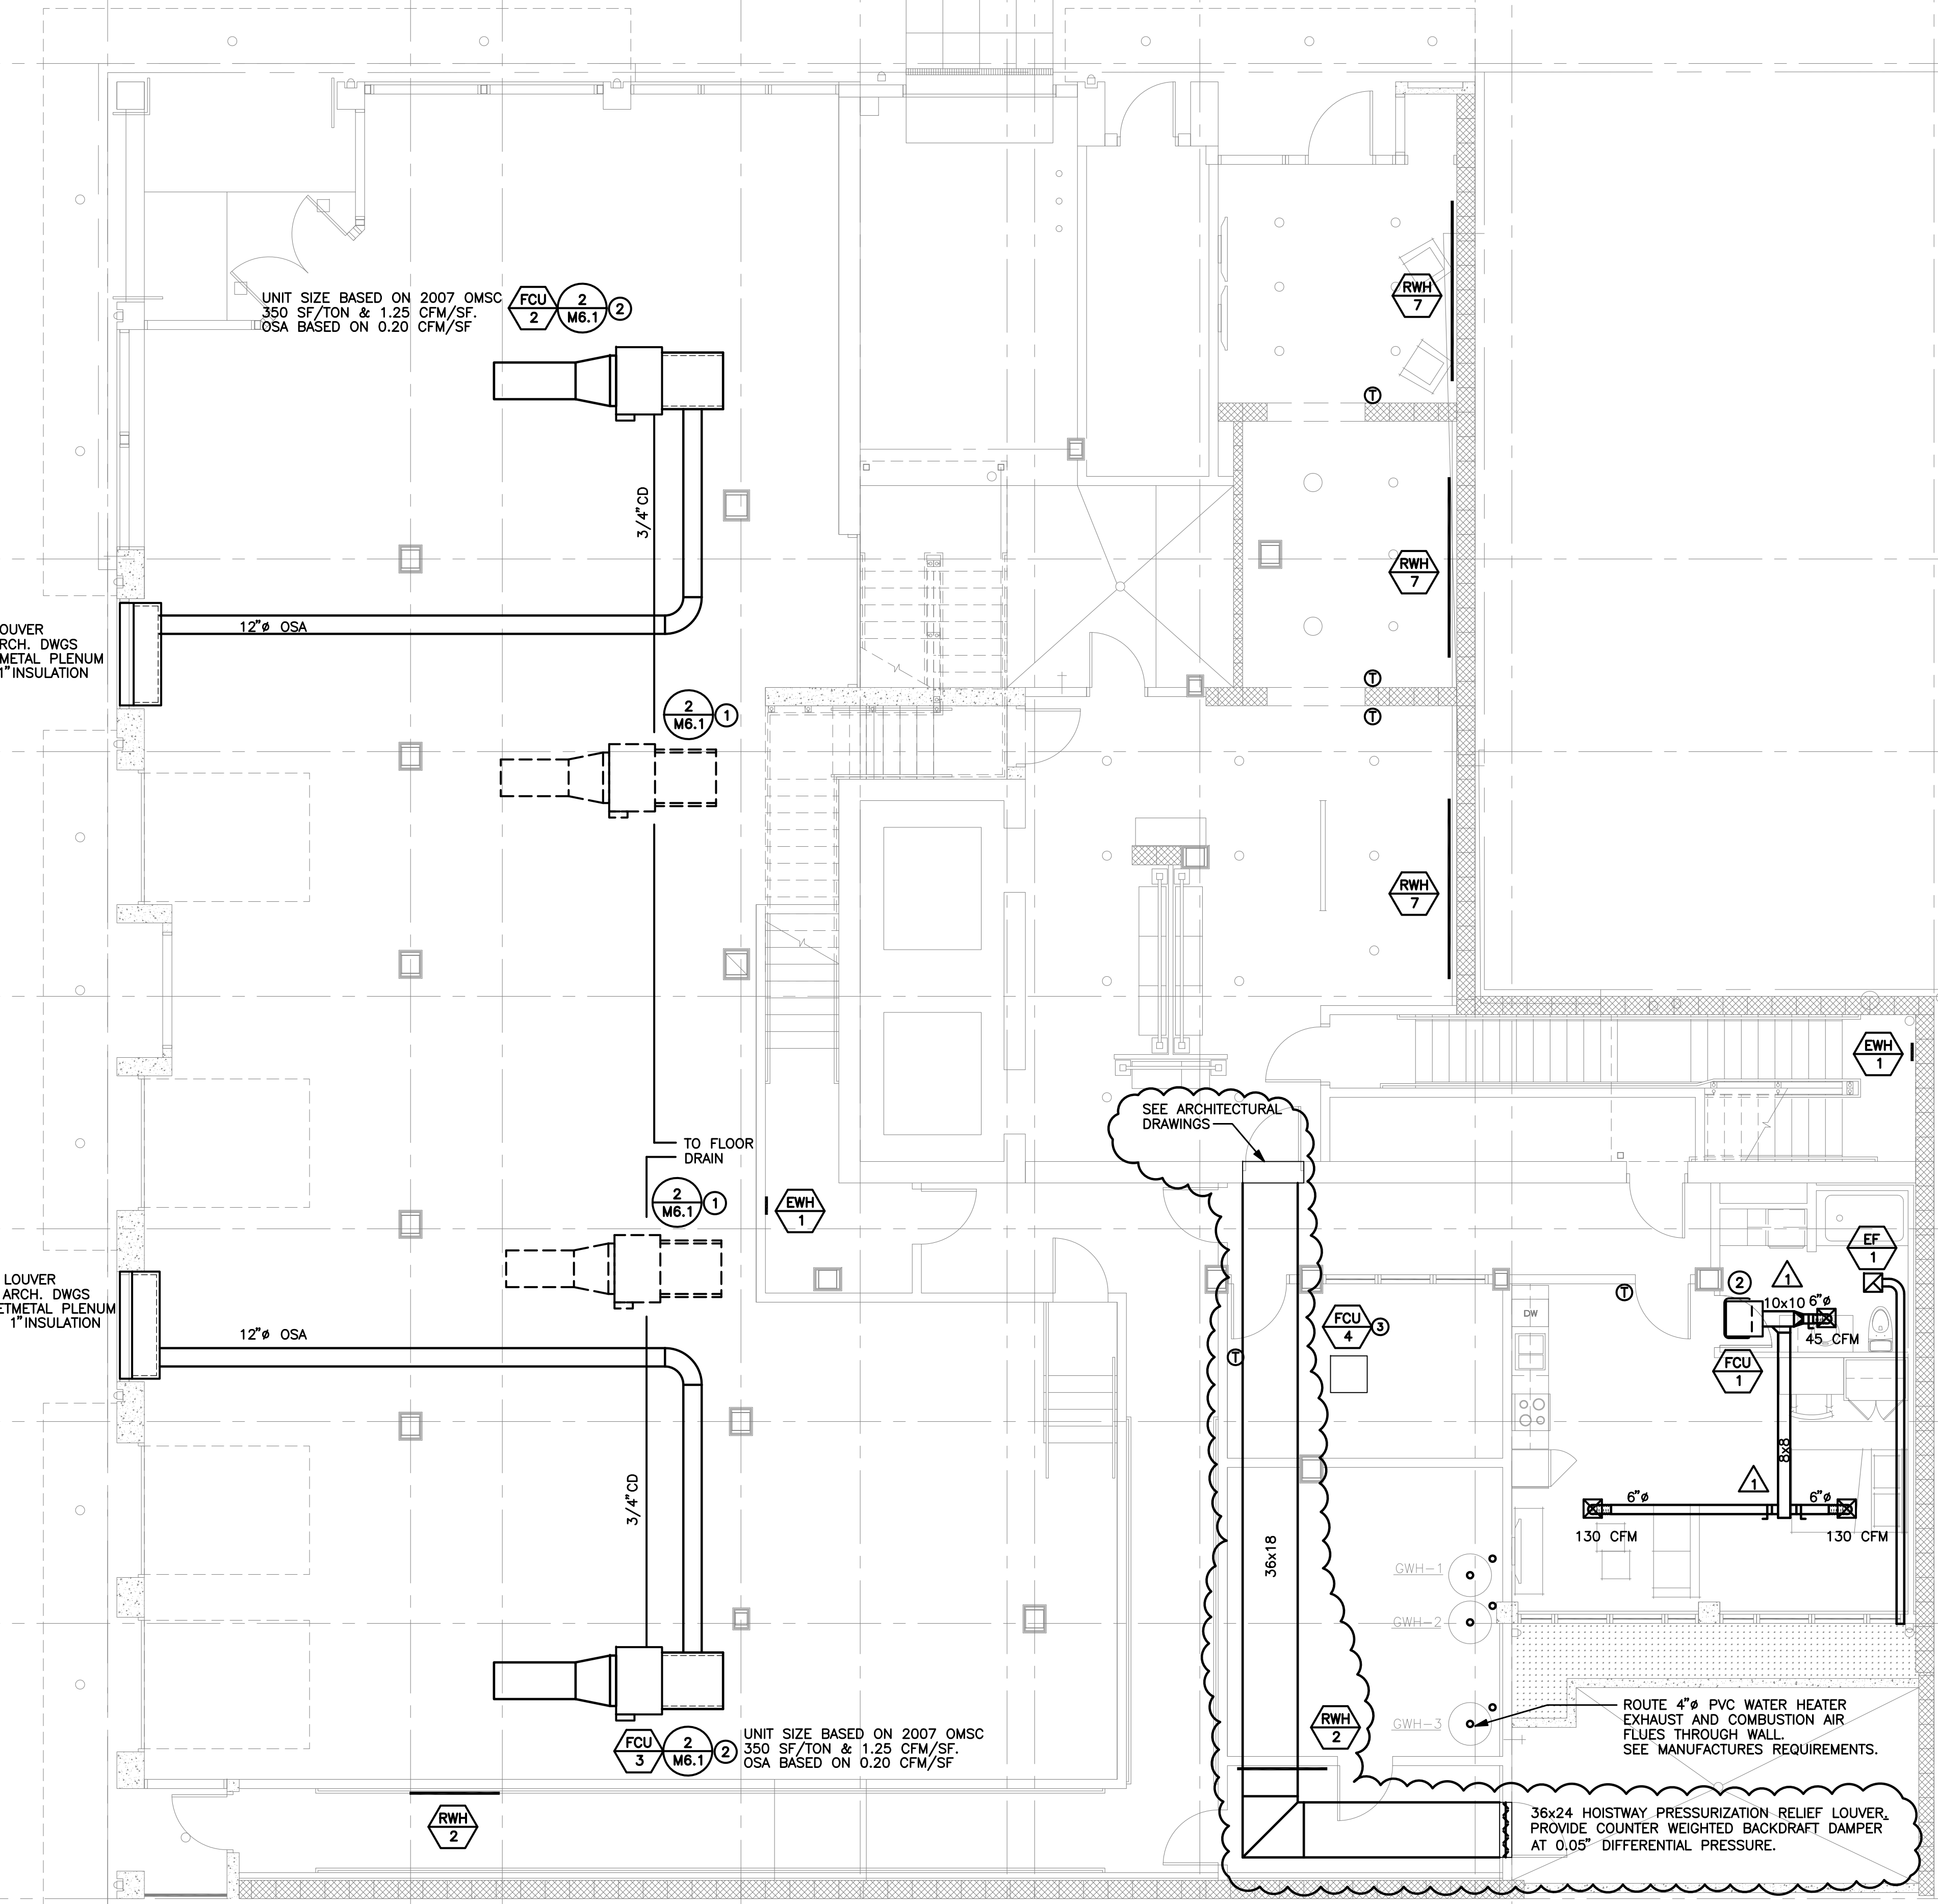


GENERAL NOTES

1. FIELD COORDINATE DUCT ROUTING WITH ARCHITECTURAL CEILING AND LIGHTING.
2. CONTRACTOR SHALL PROVIDE VERTICAL SUPPORT AND SEISMIC BRACING FOR ALL SUSPENDED MECHANICAL EQUIPMENT, DUCTWORK AND ACCESSORIES. THE SUPPORT, BRACING AND CONNECTIONS TO THE BUILDING FRAME SHALL CONFORM TO A PRE-APPROVED, CODE-COMPLIANT SYSTEM SUCH AS NUSIG.

KEYED NOTES

- ① UNIT LOCATION FOR FUTURE T.I. BUILD OUT.
- ② UNIT INSTALLED FOR FREEZE PROTECTION. LOCATION OF HORIZONTALLY MOUNTED FAN COIL UNIT. ROUTE REFRIGERANT LINES UP TO HEAT PUMP UNIT ON ROOF. ROUTE 3/4" CONDENSATE LINE FROM COIL TO DRAIN APPROVED DRAIN. INSTALL 1/2" OSA DUCT TO EXTERIOR LOUVER. DISTRIBUTION DUCTWORK TO BE DESIGNED AND INSTALLED IN FUTURE FOR T.I. BUILD OUT.
- ③ ROUTE REFRIGERANT LINES UP TO HEAT PUMP UNIT ON ROOF. ROUTE 3/4" CONDENSATE LINE FROM COIL TO DRAIN APPROVED DRAIN OR SINK TAIL PIECE.

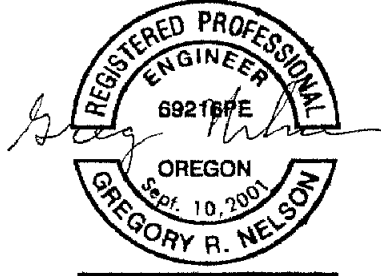

EXPIRES: 12/31/2010

BARRY R. SMITH, PC, ARCHITECT
 715 SW MORRISON STREET, SUITE 909
 Portland, OR 97205 503.295.6281 - o 503.229.0626 - f barry@barrysmith.com

INNOVATIVE HOUSING BLOCK
 for Steve Master
 5th and College, Portland, OR
 MECHANICAL FLOOR PLAN

REVISION 1 06.15.2010



PERMIT SET BID SET HUD SET

M1.1


0128.2010



1823 SW Moss St.
 Portland, OR 97219
 Ph: 503.248-5300
 Fx: 503.248.6305

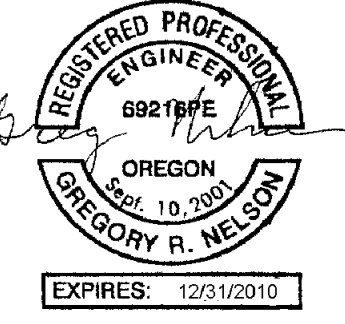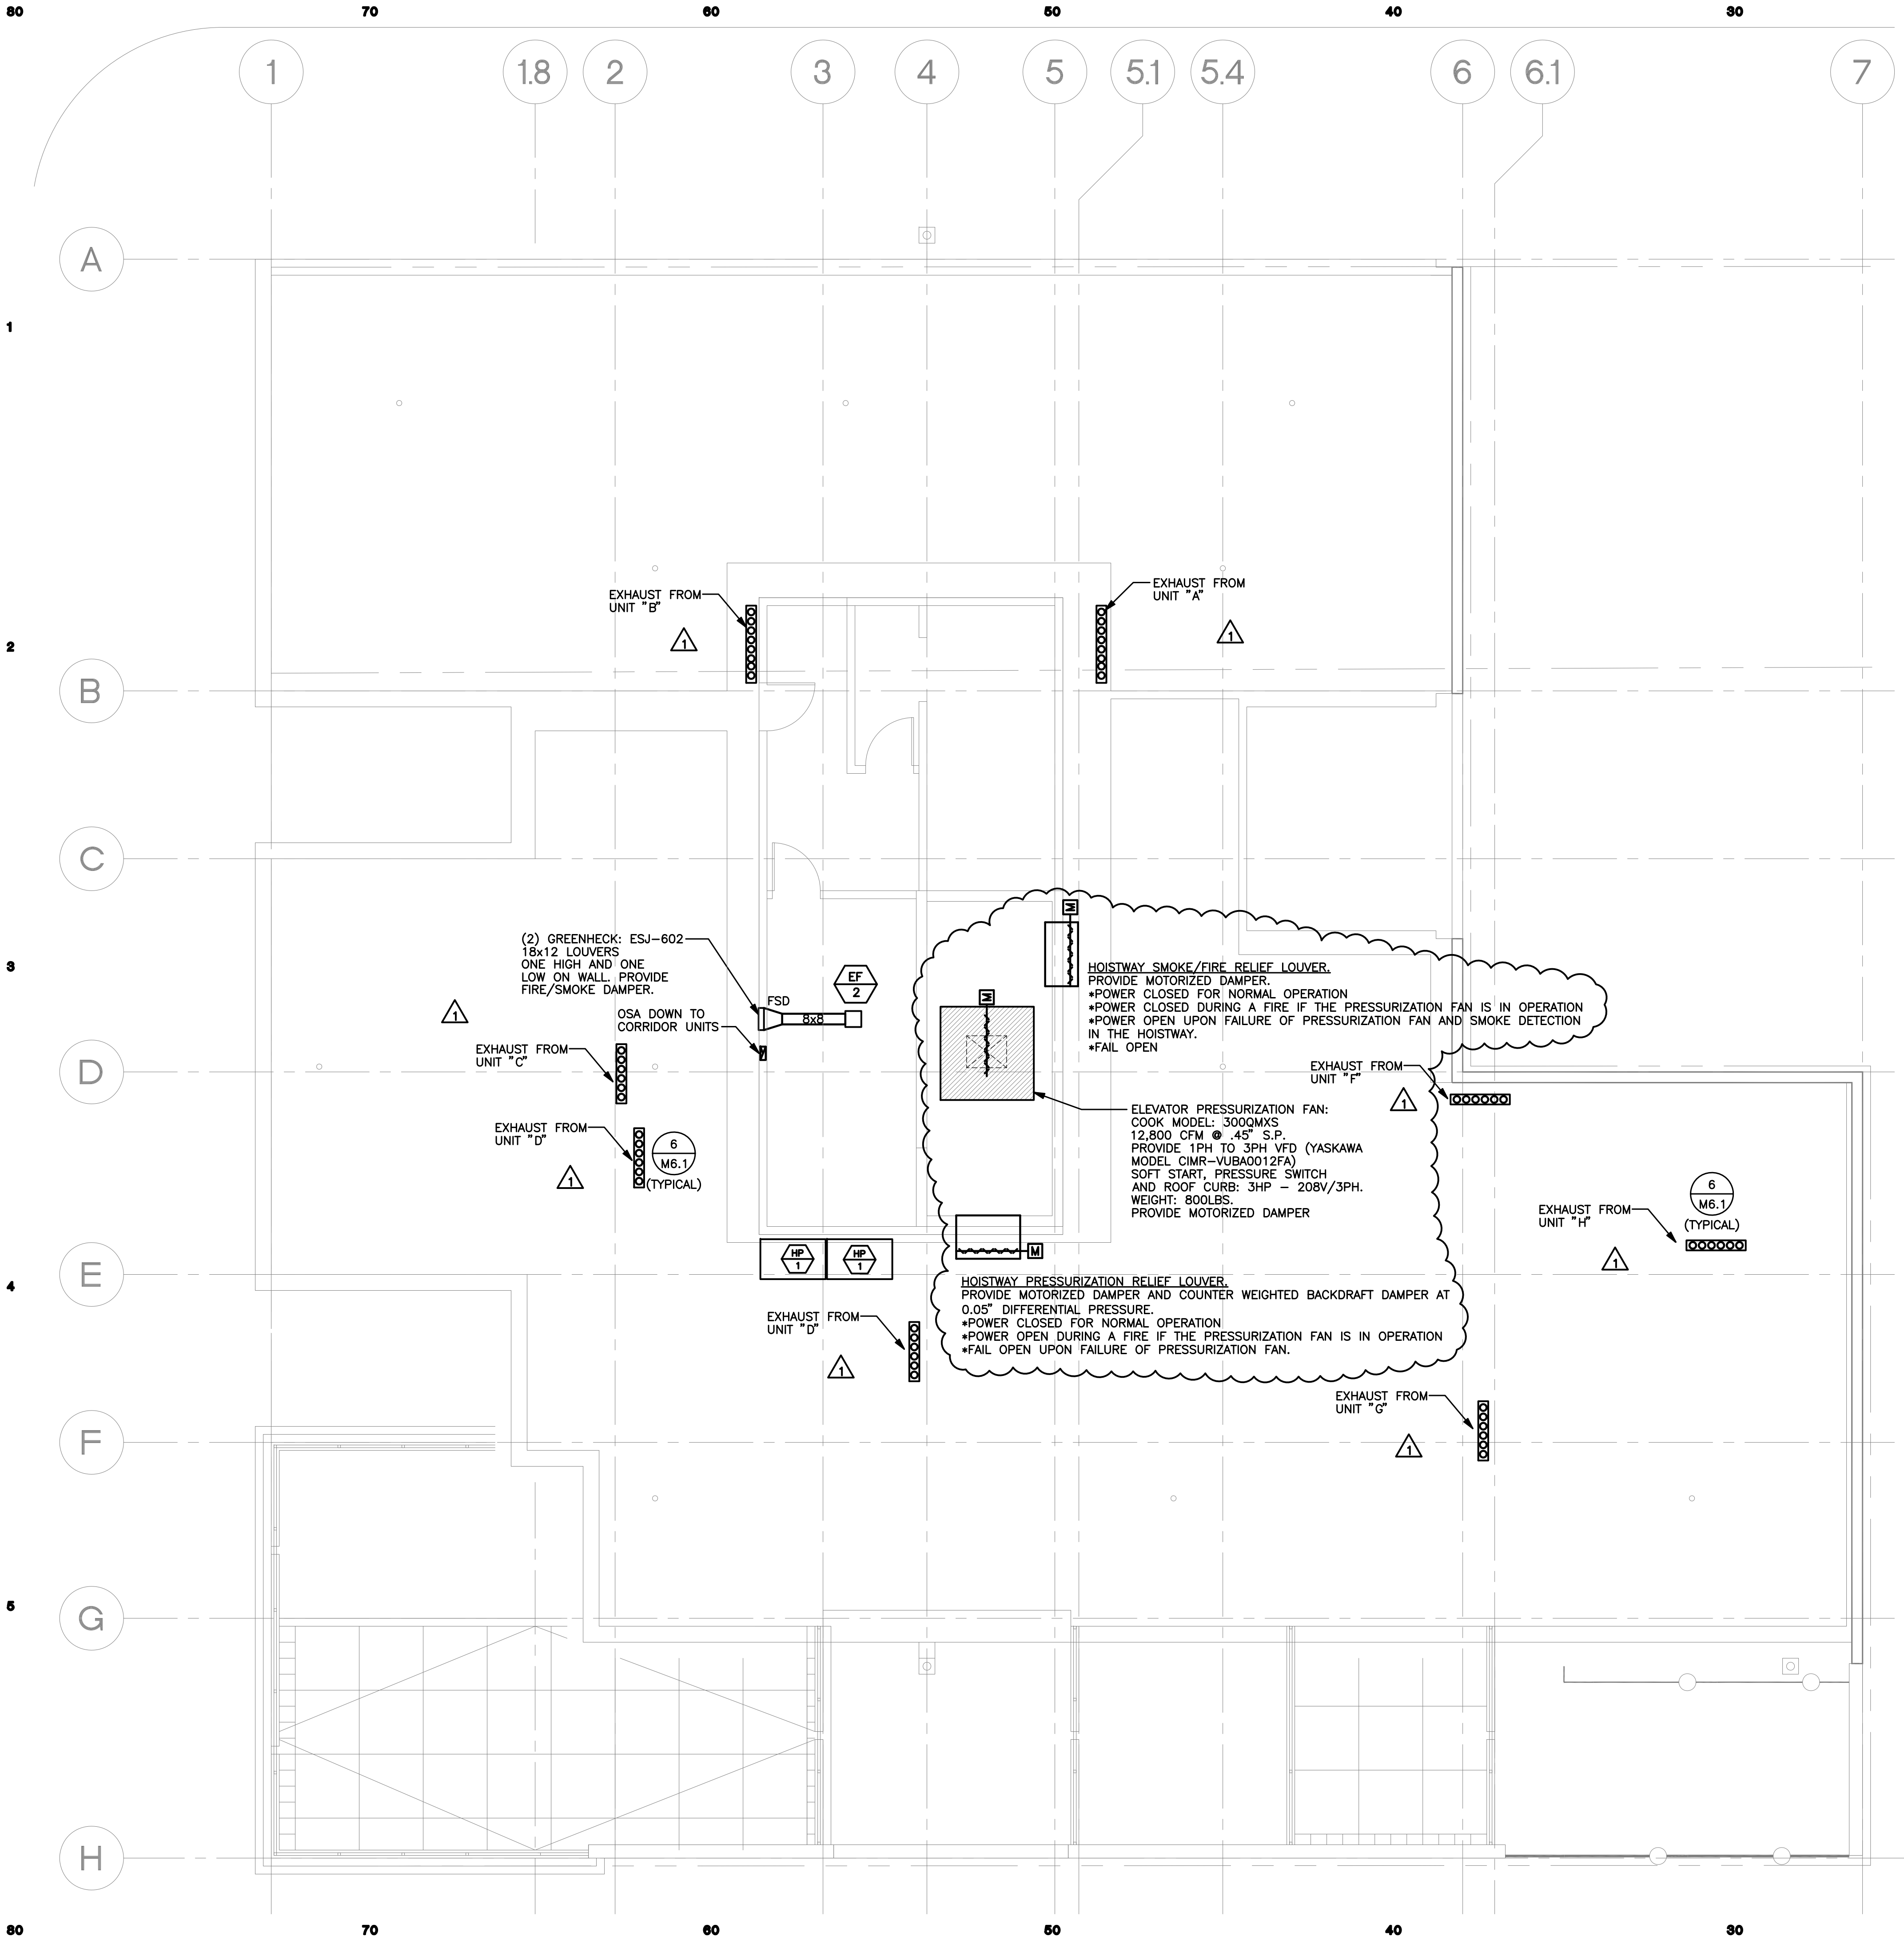

BARRY R. SMITH, PC, ARCHITECT
 715 SW MORRISON STREET, SUITE 909
 Portland, OR 97205 503.295.6281-o 503.229.0626-f barry@barrysmith.com



INNOVATIVE HOUSING BLOCK
 for Steve Master
 5th and College, Portland, OR
 MECHANICAL ROOF PLAN

REVISION 1
 06.15.2010

PERMIT SET
 BID SET
 HUD SET

M1.9

01.28.2010

MEP CONSULTING
 1823 SW Moss St.
 Portland, OR 97219
 Ph: 503.248-5300
 Fx: 503.248.6305